

CAROMA COMMERCIAL BASIN MOUNTED BOTTLE FILLER

WATER EFFICIENT TAPWARE

PLUMBERS INSTALLATION INSTRUCTIONS

Important Information

- * Not suitable for gravity feed systems.
- * Bottle filler (2) is fitted with a flow regulated 4.0L/min check valve (7). This low flow rate may not be suitable for connection to some Instantaneous Gas Water Heaters, some Tempering Valves, some Solar Water Heaters & some Thermostatic Mixing Valves. Check with the manufacturers of these products.
Note: Warranty is void if regulated check valve (7) is not installed in correct direction as shown.
- * All pipework must be thoroughly flushed prior to installation, as foreign materials may block the flow regulating device and reduce the flow of water.
- * Once the bottle filler has been installed and tested for leaks, the water flow must be adjusted to suit the available pressure, (See "Adjusting Water flow").

Installation

Ensure 'O'ring (1) is fitted into groove of bottle filler (2). Insert threaded tube (3) of bottle filler into deck hole, locate bottle filler as required, fit metal washer (5) together with flat seal (4) over threaded tube (3) of bottle filler (2) as shown in Fig. 1. Screw clamp ring (6) onto threaded tube (3) until bottle filler assembly is clamped firmly to the deck. DO NOT OVERTIGHTEN.

Adjusting Water Flow

Water flow can be adjusted by turning adjustable screw (8) 1/4 turn maximum with a flathead screwdriver. (See Fig. 2)

IMPORTANT

- This product complies with the Lead Free requirements of the National Construction Code Volume Three.
- Static inlet pressure range : 150-1000 kPa
New Regulation:- 500 kPa maximum static pressure at any outlet within a building. (Ref. AS/NZS 3500.1)
- Maximum hot water temperature : 50°C.

Deck Requirements

- Deck thickness : 45mm maximum
- Tap body hole (in deck) : Ø23-25mm

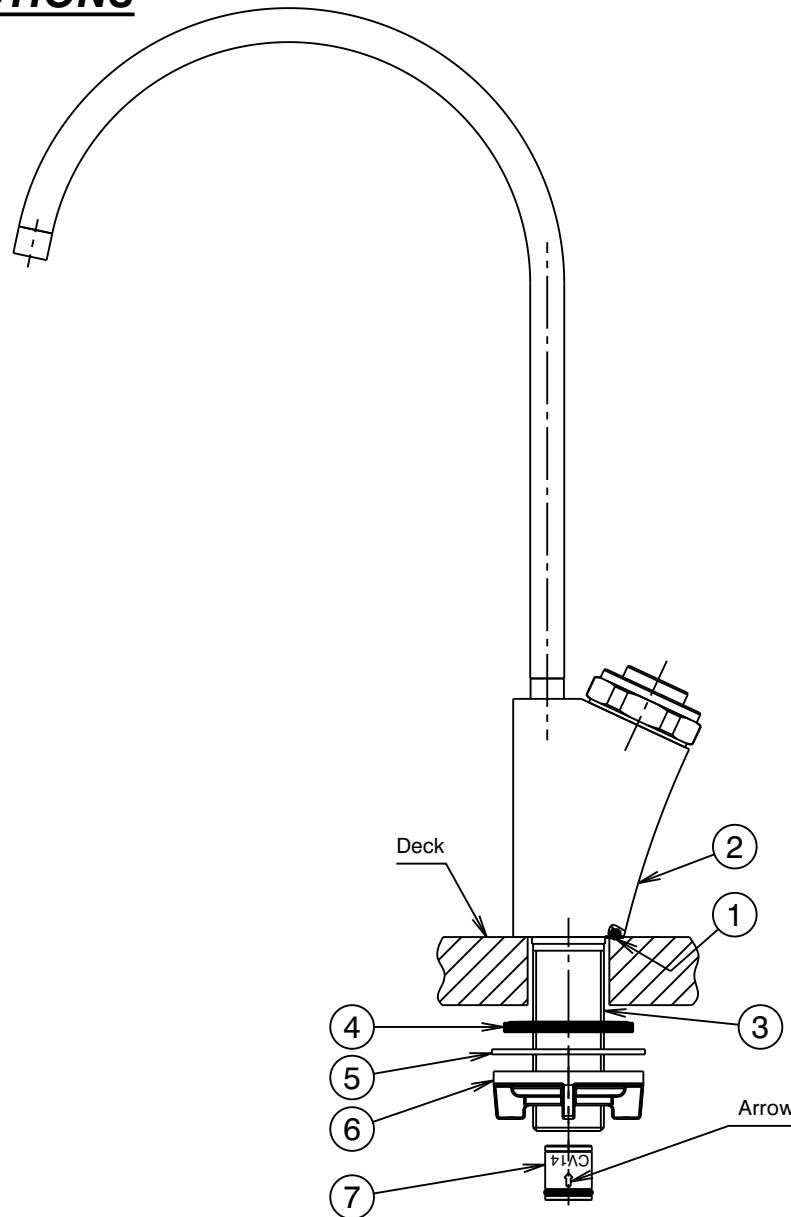


Fig.1

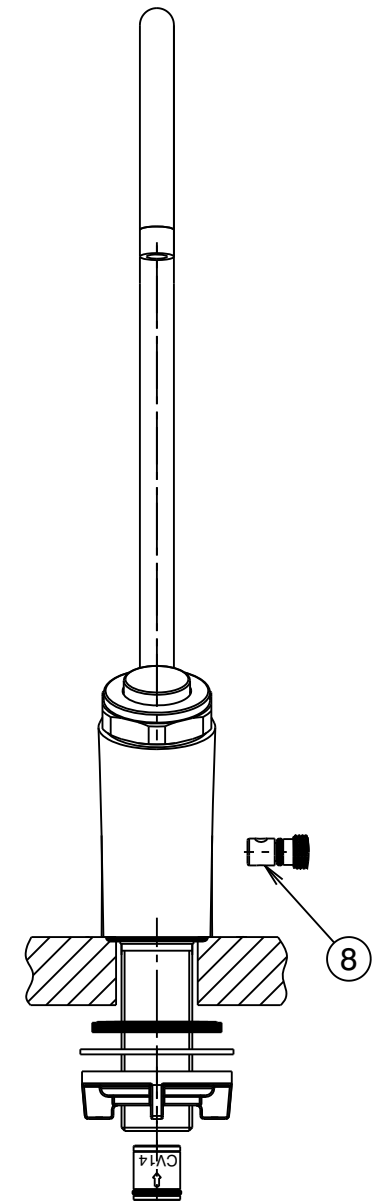


Fig.2